
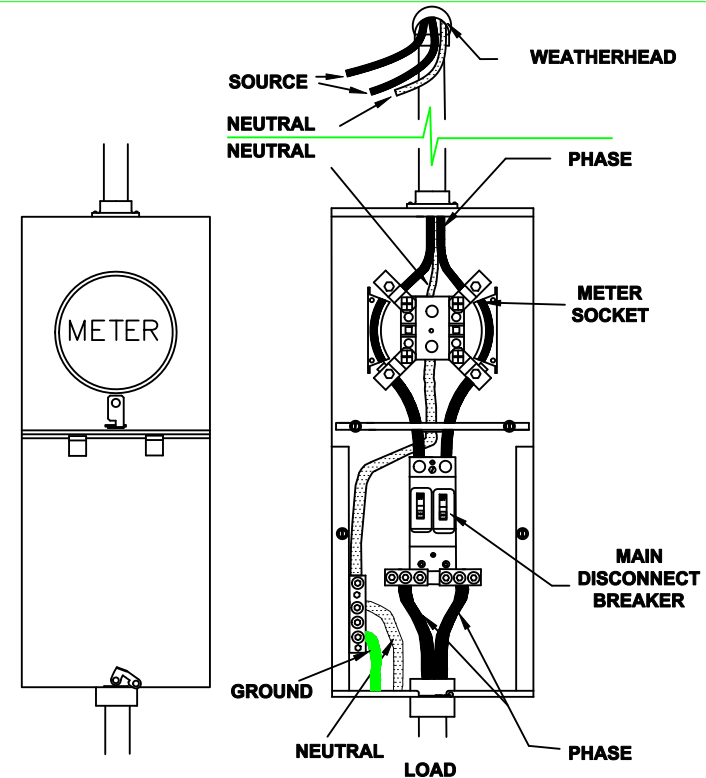


MOBILE HOME SERVICE


100 OR 200 AMP

HOME WILL NOT BE LOCATED BENEATH POWER LINES

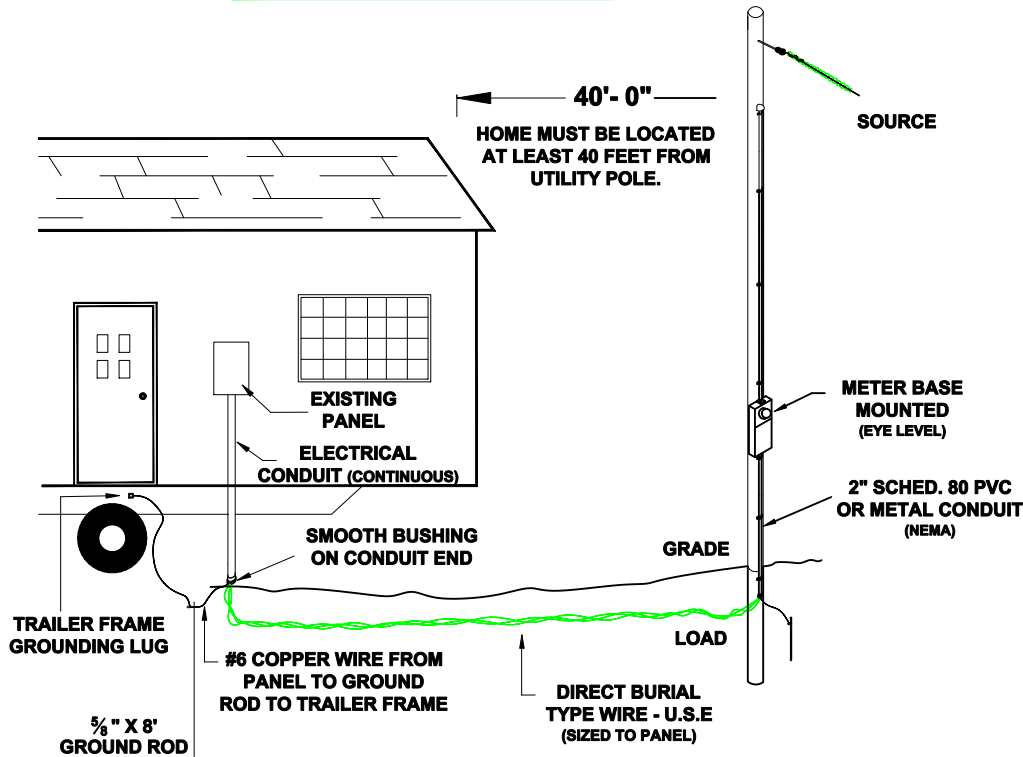


NOTE: BREC REQUIRES ALL MOBILE HOME FEEDER CONDUCTORS TO CONSIST OF FOUR (4) INSULATED COLOR CODED CONDUCTORS. EQUIPMENT GROUNDING CONDUCTORS SHALL BE IDENTIFIED BY GREEN INSULATION, THE ENTIRE LENGTH OF THE RUN.

DITCH DETAIL

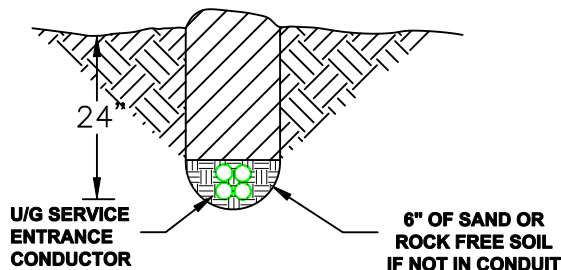

PANEL REQUIREMENTS

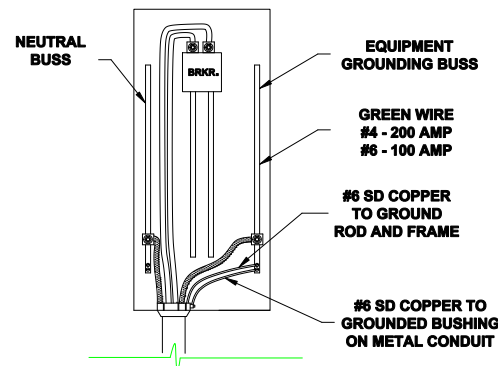

100 AMP
#2 - #2 - #4 - #6 AL

200 AMP
4/0 - 4/0 - 2/0 - #4 AL



BLACK RIVER ELECTRIC COOP

2600 HIGHWAY 67

FREDERICKTOWN, MO 63645

DRAWN: R.A.
DATE: 9/4/15

CHECKED: D.B.
DATE: 9/20/15

APPROVED: P.M.
DATE: 9/30/15

REVISIONS

REV	DESCRIPTION	DATE	APPROVED
---	---	---	---
---	---	---	---